

Low Voltage Wall Switch Occupancy Sensor

Cat. No. OSS24 - 24VDC (requires power pack)

LEVITON[®]

WARNINGS AND CAUTIONS

- **TO AVOID FIRE, SHOCK, OR DEATH: TURN OFF POWER** at circuit breaker or fuse and test that power is off before wiring!
- To be installed and/or used in accordance with electrical codes and regulations.
- Confirm that device ratings are suitable for application prior to installation.
- Use this device **with copper or copper clad wire only**.
- Connect to field wiring rated for 60° C or greater.
- DO NOT install if product appears to be damaged.
- For indoor use only.
- Read these instructions before installation and retain for future reference.

DI-000-OSS24-05A

INSTALLATION INSTRUCTIONS

ENGLISH

DESCRIPTION

The OSS24 Wall Switch is a low voltage (24V) intelligent self-adapting occupancy sensor that is designed to replace existing wall switches.


SPECIFICATIONS

- 1000 sq. ft. coverage area
- Passive Infrared (PIR) sensor with dual-element pyrometer and 12-element cylindrical lens
- 24VDC (requires power pack)
- Adjustable Time Delay: 4-30 minutes; self-adjusts based on occupancy
- Light Level Adjustment: 10 to 500FC
- UL, cUL Listed

INSTALLATION

1. **WARNING: TO AVOID FIRE, SHOCK, OR DEATH: TURN OFF POWER** at circuit breaker or fuse and test that power is off before wiring!
2. Remove the old switch if applicable.
3. Wire as shown in WIRING DIAGRAM. NOTE: OSS24 requires one power pack per output.
4. Install sensor in wall box using mounting screws provided.
5. Restore power to the sensor and allow it to initialize (up to 2 minutes).
6. Sensor is factory configured to provide the most energy savings. If additional adjustments are required, see the ADJUSTMENTS section.
7. If daylight harvesting is desired, calibrate the sensor's photocell as described in the PHOTOCCELL CONTROL section.
8. Install wall plate (not included). **Installation is complete.**

WIRING DIAGRAM

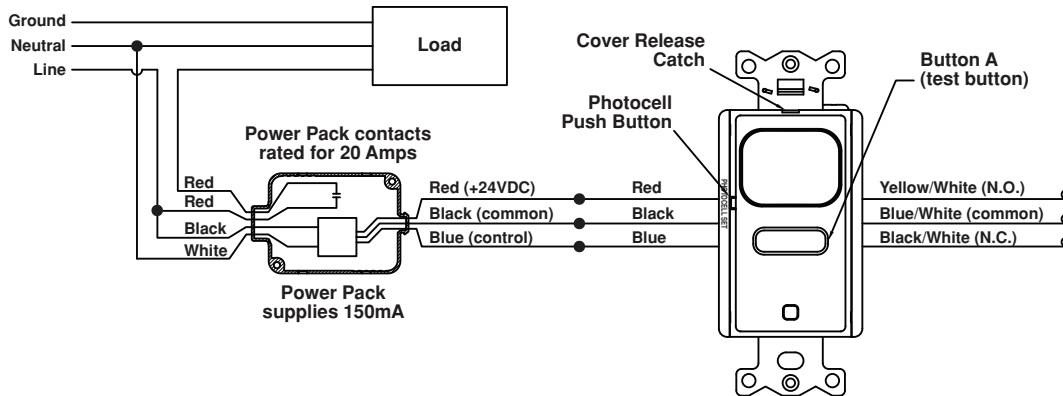

TEST MODE

1. Ensure lights are ON.
2. Press and hold the ON/OFF button. Lights will cycle OFF then back ON. Release the ON/OFF button.
3. Sensor is now in Test Mode (*NOTE: While in Test Mode the sensor will operate in Automatic ON/Automatic OFF mode*). Vacate room; lights should turn OFF after 5 seconds. Wait 5 seconds after turn OFF before re-entering space. Step back into room, lights will turn back ON. Repeat walk test as necessary to confirm sensor is operating and detecting in the area as desired. Sensor will flash red LED when detecting occupancy.
4. To exit Test Mode, press any button (*NOTE: Sensor will automatically exit Test Mode after sixty (60) minutes*).

MANUAL OVERRIDE

Press button(s) to toggle lights ON or OFF. Lights will remain in the last state determined by the buttons while occupancy is detected. Sensor will return to the programmed mode of operation when the sensor times out.

PHOTOCCELL CONTROL

The photocell is used to detect if other light sources such as sunlight, are sufficient to illuminate the space without turning on the controlled lights. The sensor is shipped from the factory with the photocell control disabled. If use of the photocell is desired, calibrate the photocell set point as follows:

1. With the light level at the desired level where the controlled lights should be off, PRESS and RELEASE the photocell set button using the end of a paper clip or small bladed screwdriver.
2. Step back from the sensor to avoid changing ambient light levels in the room. During calibration the sensor will turn the lights OFF then back ON.
3. After the calibration process, the sensor will return to its programmed mode of operation. During occupancy, the sensor will turn lighting OFF sixty (60) seconds after reaching or exceeding the set point level. When the lighting level drops below the set point level the sensor will turn the lights ON.

ADJUSTMENTS

The following switch adjustments require that the sensor's cover be removed. Remove the cover by inserting a small blade screwdriver into the catch at the top of the sensor and gently pry the cover off. Set the adjustment switches as desired (see CONFIGURATION SWITCH SETTINGS section). Factory default is all switches OFF. To re-install cover, place cover directly over the sensor and align the cover's four (4) catches with the recesses in the sensor housing. Snap cover onto housing making sure that all catches are securely in place.

WEB VERSION

CONFIGURATION SWITCH SETTINGS - BANK A

Switch 1 - Relay 1 Sensor Operation

Programs the sensor for either Manual ON/Automatic OFF operation or Automatic ON/Automatic OFF operation. When set to Manual ON/Automatic OFF mode, lights are turned ON by manually pressing the ON/OFF button. If the sensor times out and turns the lights OFF in the Manual ON/Automatic OFF mode while the space is still occupied, any motion detected within thirty (30) seconds will automatically turn the lights back ON, without requiring the user to press the ON button.

Switch 2 - *NOTE: Switch 2 has no function on single relay models.*

Switch 3 - Adaptive or Fixed Timer

Controls selection between Adaptive Timer Mode and Fixed Timer Mode. In Adaptive Timer Mode, the sensor automatically self-adjusts its timeout delay to optimize energy savings. The sensor will initialize its timer value to eight (8) minutes. If the Bank B Timer Select 0 and Timer Select 1 switches have been set to four (4) minutes, this will be the smallest timer value used. In Fixed Timer Mode, the sensor's self-adapting timer functions are disabled and the sensor's timeout delay is set according to the Bank B Timer Select 0 and Timer Select 1 switch settings.

Switch 4 - Adaptive Reset

The sensor is equipped with self-adaptive technology which automatically adjusts the sensor's sensitivity and timer settings to optimize performance based on occupancy patterns. The sensor constantly learns and adjusts appropriately. If the learned settings need to be reset (e.g. when relocating sensor to another area), toggle the switch ON then OFF. The adaptive timer is reset according to the Bank B Timer Select 0 and Timer Select 1 switches. The adaptive sensitivity is reset to factory default. The photocell sensor settings are also reset to factory default (disabled) such that the sensor will turn on the light(s) in response to occupancy regardless of ambient light levels in the lighted space. (*NOTE: Adaptive reset can also be achieved by pressing and holding the photocell set button for ten (10) seconds.*)

Switch 5 - Relay Bypass

If it is necessary to service the controlled circuits without de-energizing them at the breaker panel (*NOTE: this is not recommended as a standard procedure*), perform the following steps:

1. With the lights ON, set the relay bypass switch to the ON position.
2. Push the button(s) to turn the lights OFF.
3. Push the button(s) again to verify override (lights should not come back on).

The relay bypass switch will now interrupt sensor operation, preventing output(s) from turning ON again, regardless of occupancy or pushbutton conditions. To return the sensor to normal operation, flip the relay bypass switch to the OFF position. To confirm sensor is operating normally, lights should now turn ON and OFF when the button(s) are pressed.

CONFIGURATION SWITCH SETTINGS - BANK B

Switches 1 and 2 - Timer Settings

Sets the length of time lights will remain ON after last motion is detected. The timeout value can be set to 4, 8, 16 or 30 minutes. See **Bank A - Switch 3 - Adaptive or Fixed Timer** section for additional information.

Switches 3 and 4 - Sensing Technology Enable/Disable

Enables or disables the occupancy sensing technologies used by the sensor. If all sensing technologies are disabled, sensor operates as a manual ON/OFF switch.

Switch 5 - Sensitivity

Sets the sensor's initial Passive Infrared (PIR) sensitivity level. Sensitivity can be set to either High or Low.

Switch Bank A	Function	← OFF		ON →	
1	Relay 1 Operation	Manual ON/Automatic OFF		Automatic ON/Automatic OFF	
2	Not functional on Single Relay models	Manual ON/Automatic OFF		Automatic ON/Automatic OFF	
3	Timer Mode	Adaptive		Fixed	
4	Adaptive Reset	Enable Adaptation		Restore Factory Default	
5	Relay Bypass	Normal Operation		Relay Override	
Switch Bank B	Function	← OFF		ON →	
1	Timer Select 0	→	←	←	→
2	Timer Select 1	←	←	→	→
Time		4 Min	8 Min	16 Min	30 Min
3	Program Occupancy Light Level	Enabled		Disabled	
4	*Non-functional	N/A		N/A	
5	Sensitivity	High		Low	

* Only functional on multi-tech models.

FOR CANADA ONLY

For warranty information and/or product returns, residents of Canada should contact Leviton in writing at **Leviton Manufacturing of Canada Ltd to the attention of the Quality Assurance Department, 165 Hymus Blvd, Pointe-Claire (Quebec), Canada H9R 1E9** or by telephone at **1 800 405-5320**.

LIMITED 5 YEAR WARRANTY AND EXCLUSIONS

Leviton warrants to the original consumer purchaser and not for the benefit of anyone else that this product at the time of its sale by Leviton is free of defects in materials and workmanship under normal and proper use for five years from the purchase date. Leviton's only obligation is to correct such defects by repair or replacement, at its option. **For details visit www.leviton.com or call 1-800-824-3005.** This warranty excludes and there is disclaimed liability for labor for removal of this product or reinstallation. This warranty is void if this product is installed improperly or in an improper environment, overloaded, misused, opened, abused, or altered in any manner, or is not used under normal operating conditions or not in accordance with any labels or instructions. **There are no other or implied warranties of any kind, including merchantability and fitness for a particular purpose, but if any implied warranty is required by the applicable jurisdiction, the duration of any such implied warranty, including merchantability and fitness for a particular purpose, is limited to five years. Leviton is not liable for incidental, indirect, special, or consequential damages, including without limitation, damage to, or loss of use of, any equipment, lost sales or profits or delay or failure to perform this warranty obligation.** The remedies provided herein are the exclusive remedies under this warranty, whether based on contract, tort or otherwise.